
# Our Fuses in Voltage Transformers



interteknik

### **VOLTAGE TRANSFORMERS**

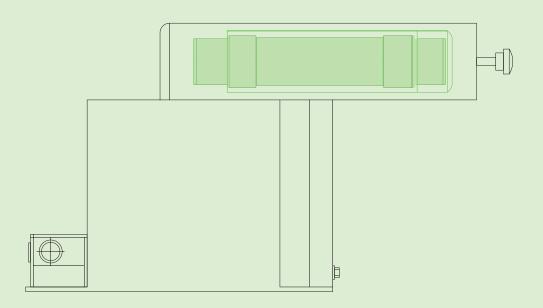

### **Features**

- Non-aging design
- High breaking currents up to 63 kA, along with small rated currents
- A big range of specific dimensions to fit in your installation
- Technical assistance in fuse selection & operation
- Project-basis design

### Overview

Voltage transformers are designed to convert a primary high voltage of a power grid into an acceptably lower voltage to feed measuring and protective devices. Voltage transformer are low power high impedance items that operate at low current levels. In contrast to the low operating currents, fault currents in case of insulation failure may be extremely high as voltage transformers are often installed at the substation bus. Therefore, HV current-limiting fuses having **high breaking capacity** will preferably be used to isolate failed voltage transformers from the power system and to prevent potentially catastrophic consequences. Inter-Teknik fuses combine **low continuous current ratings** with **high rated maximum breaking current**.

# **Fuse Selection Criteria**

- 1. Optimum protection against damage to other equipment in the event of an insulation failure of the voltage transformer requires selecting a possibly small current rating.
- 2. Major fuse selection criterion is to **withstand magnetizing inrush currents** in order to avoid nuisance tripping. As a rule, this condition excludes effective overload protection of a voltage transformer.

# **Practical Tools for Selection**

1. The pre-arcing I2t of the fuse should be at least 5 times greater than the inrush

I2t. This will give a reason- able safety margin for preventing nuisance tripping of the fuse.

2. If inrush I2t values are unavailable, the fuse rated current may be selected 15 to 20 times the voltage trans- former rating.

# Tips to Avoid Failures

Fuse-element design of fuses at very low rated currents, are by nature susceptible to mechanical and inrush damage. Certain precautions should be taken as follows;

1. In small metal-enclosed grounded fuse compartments, the effect of sustained partial discharges-"corona" - generated by high electric stress at the fine fusewire, need to be considered as electro-erosion that will degrade the delicate fuse-element with time.

Solution: Partial discharge measurement with the fuse installed is recommended to avoid that risk.

2. In some applications, particularly in networks with isolated neutral, there is a risk that the inherent capacitance of the circuit will give rise to a discharge current through the primary windings of the voltage transformer that triggers relaxation oscillations; also known as **ferroresonance**. Such chaotic oscillations may last until destruction of the voltage transformer.

Solution: Precautions, such as damping resistors installed at the LV windings, should be taken ensuring that the fuse would not operate under these conditions.

3. Risks of mechanical damages during transport or operation should be minimized.

Solution: Due to delicate nature of these fuses, **fuse-link handling guide** should be strictly followed.

Similar to other applications, we provide our clients with a non-ageing, high quality, high breaking capacity solution. With our dedication to fuse manufacturing, we offer flexibility of providing our customers with specific dimensions and characteristics depending on the project requirements.



### www.inter-teknik.com.tr

## **Headquarters**

Kemankeş Cad. Fransız Geçidi İş Merkezi No:53 C Blok D:16 Karaköy, Beyoğlu / İstanbul-TR T +90 212 249 84 58 / 244 32 49

### **Factory**

Şekerpınar Mah. Marmara Geri Dönüşümcüler Yapı Koop. Defne Sok. No:3 Çayırova / Kocaeli -TR T +90 262 658 93 11